

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 1 (A1)

Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and Half-hourly Average Monitoring Data

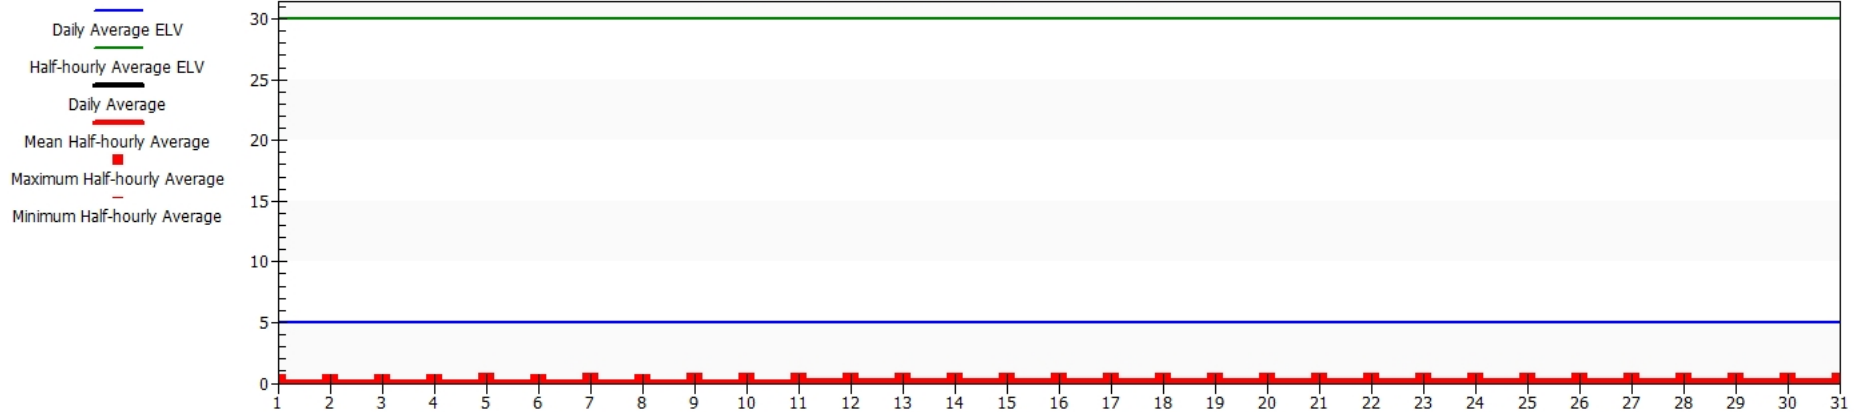

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0		
	Monthly maximum	0.2	Maximum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2		
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.1	0.2	
	Monthly minimum	0.1	Minimum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	Monthly maximum	0.2	Daily average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.1	0.2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and Half-hourly Average Monitoring Data

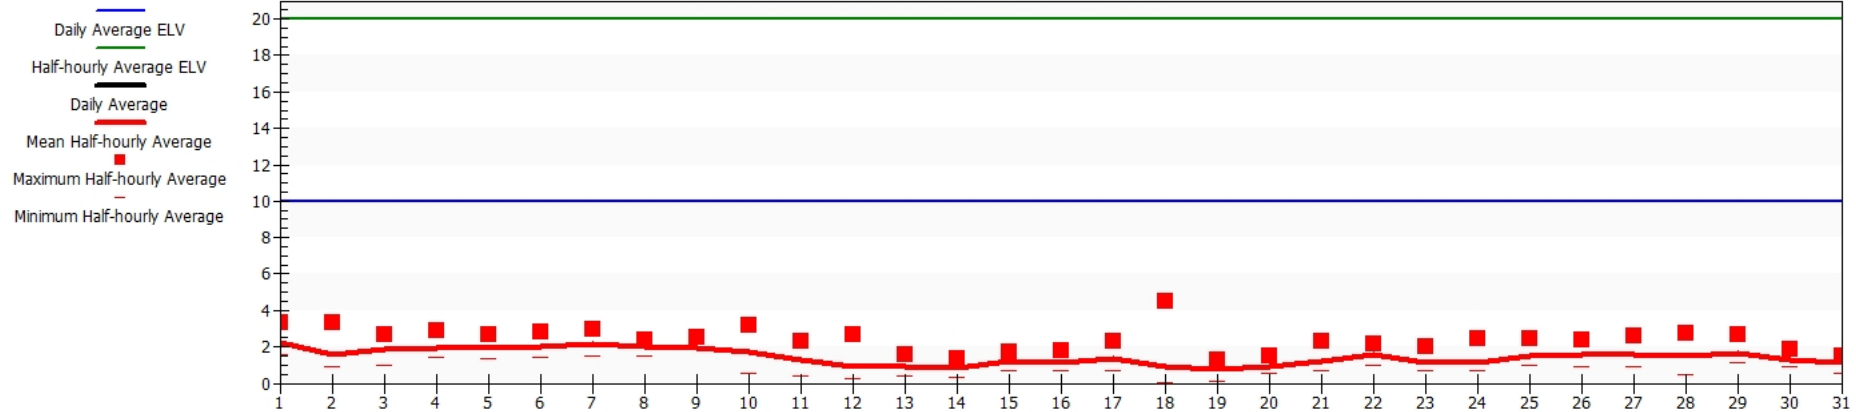

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	
	Monthly maximum	4.5	Maximum Half-hourly average	3.3	3.3	2.6	2.9	2.7	2.8	2.9	2.4	2.5	3.2	2.3	2.7	1.6	1.3	1.7	1.8	2.3	4.5	1.3	1.5	2.3	2.1	2.0	2.4	2.4	2.4	2.6	2.7	2.7	1.9	1.5	
	Monthly mean	1.5	Mean Half-hourly average	2.2	1.6	1.9	2.0	1.9	2.0	2.2	2.0	1.9	1.7	1.3	0.9	0.9	0.9	1.2	1.2	1.4	0.9	0.7	0.9	1.2	1.5	1.2	1.2	1.5	1.5	1.6	1.5	1.6	1.3	1.2	
	Monthly minimum	0.0	Minimum Half-hourly average	1.6	0.9	1.0	1.5	1.3	1.5	1.5	1.5	0.0	0.6	0.4	0.2	0.4	0.3	0.7	0.7	0.7	0.0	0.1	0.5	0.7	1.0	0.7	0.7	1.0	0.9	0.9	0.5	1.2	0.9	0.6	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	2.2	Daily average	2.2	1.6	1.9	2.0	1.9	2.0	2.2	2.0	1.9	1.7	1.3	0.9	0.9	0.9	1.2	1.2	1.4	0.9	0.7	0.9	1.2	1.5	1.2	1.2	1.5	1.5	1.6	1.5	1.6	1.3	1.2	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and Half-hourly Average Monitoring Data

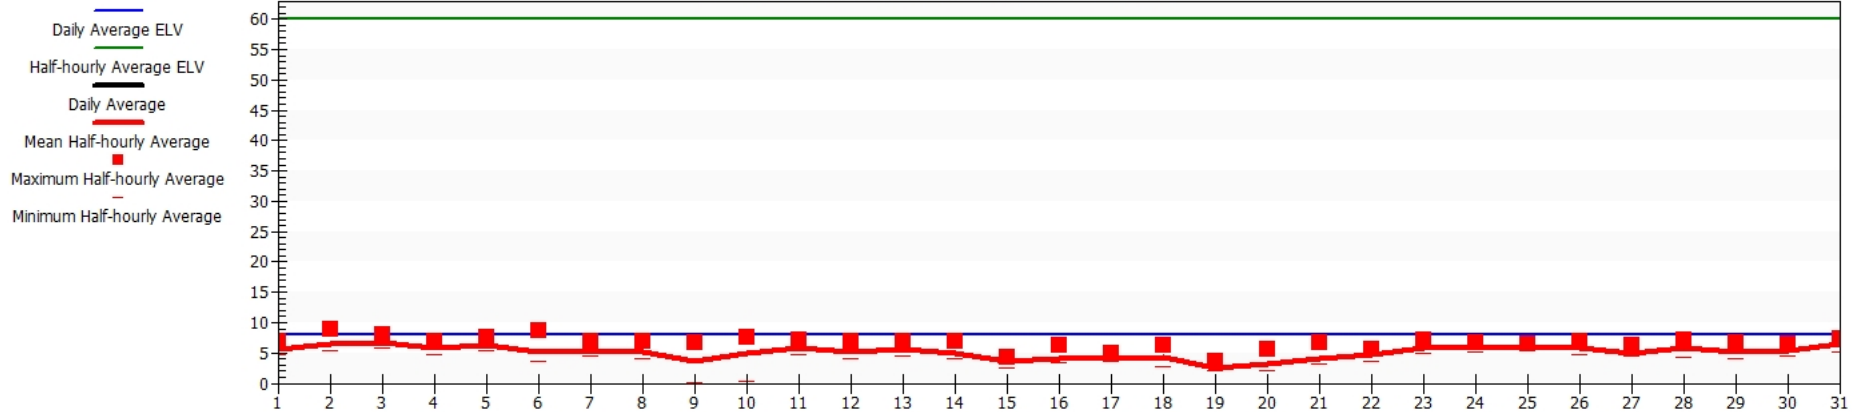

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0		
	Monthly maximum	8.9	Maximum Half-hourly average	6.9	8.9	7.9	7.0	7.5	8.6	6.9	6.8	6.7	7.6	7.1	6.9	6.9	6.9	4.2	6.2	4.9	6.3	3.6	5.6	6.7	5.6	7.2	6.7	6.6	6.8	6.2	7.2	6.8	6.5	7.3	
	Monthly mean	5.1	Mean Half-hourly average	5.6	6.5	6.7	5.7	6.2	5.1	5.4	5.2	3.5	4.9	5.8	5.1	5.6	4.9	3.5	4.2	4.0	4.2	2.6	3.3	4.1	4.8	5.9	5.9	6.0	5.8	5.0	5.8	5.2	5.5	6.5	
	Monthly minimum	0.0	Minimum Half-hourly average	4.7	5.4	5.9	4.7	5.3	3.6	4.5	4.1	0.0	0.4	4.6	4.2	4.5	4.0	2.6	3.4	3.5	2.8	2.1	2.1	3.3	3.5	5.0	5.3	5.4	4.7	4.4	4.3	4.0	4.4	5.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	
	Monthly maximum	6.7	Daily average	5.6	6.5	6.7	5.7	6.2	5.1	5.4	5.2	3.5	4.9	5.8	5.1	5.6	4.9	3.5	4.2	4.0	4.2	2.6	3.3	4.1	4.8	5.9	5.9	6.0	5.8	5.0	5.8	5.2	5.5	6.5	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N


Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)

Reporting of Continuously Monitored Emissions to Air for CO mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and 10 Minute Average Monitoring Data

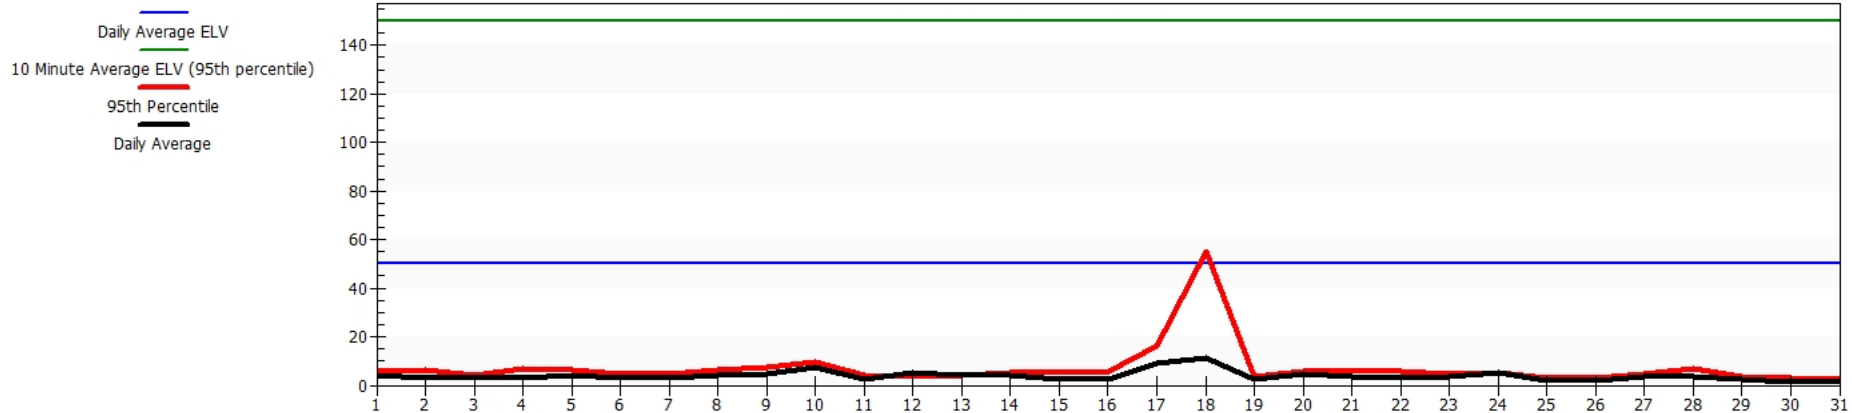

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
10 Minute average		10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	
	Monthly Maximum 10-min	393	Maximum 10 Minute average	95	61	17	25	60	6	12	185	169	278	10	393	291	126	17	20	279	289	20	149	54	42	108	267	4	32	214	78	81	8	3
	Monthly mean 10-min avgs	4	95th Percentile	6	7	4	7	7	4	5	6	7	10	4	4	4	5	5	6	16	55	3	6	6	6	5	5	3	3	5	7	3	3	3
	Monthly Minimum 10-min	0	Minimum 10 Minute average	1	0	1	1	1	1	1	1	1	1	1	0	0	0	1	0	0	1	1	1	1	1	1	0	0	0	0	0	0	0	1
	Total Invalid results	2	No of Invalid results	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0
			Number of results above 150mg/m³	0	0	0	0	0	0	0	1	1	2	0	1	1	0	0	0	2	4	0	0	0	0	0	1	0	0	1	0	0	0	0
		Sum of Exceedances of 95th percentile ELV	0	95th Percentile ELV Exceeded (Y/N)																														
Daily average		Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
	Monthly maximum	11	Daily average	4	3	3	3	4	3	3	4	5	8	3	5	4	4	2	2	9	11	2	4	4	3	4	5	2	2	3	3	3	1	2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV? (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....**REDACTED**.....

Date.....**23.01.25**.....

(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m3, and 5% (= 7) are allowed to be any value above 150 mg/m3. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m3, provided the 95th percentile ELV has been met for that period

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO2 mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and Half-hourly Average Monitoring Data

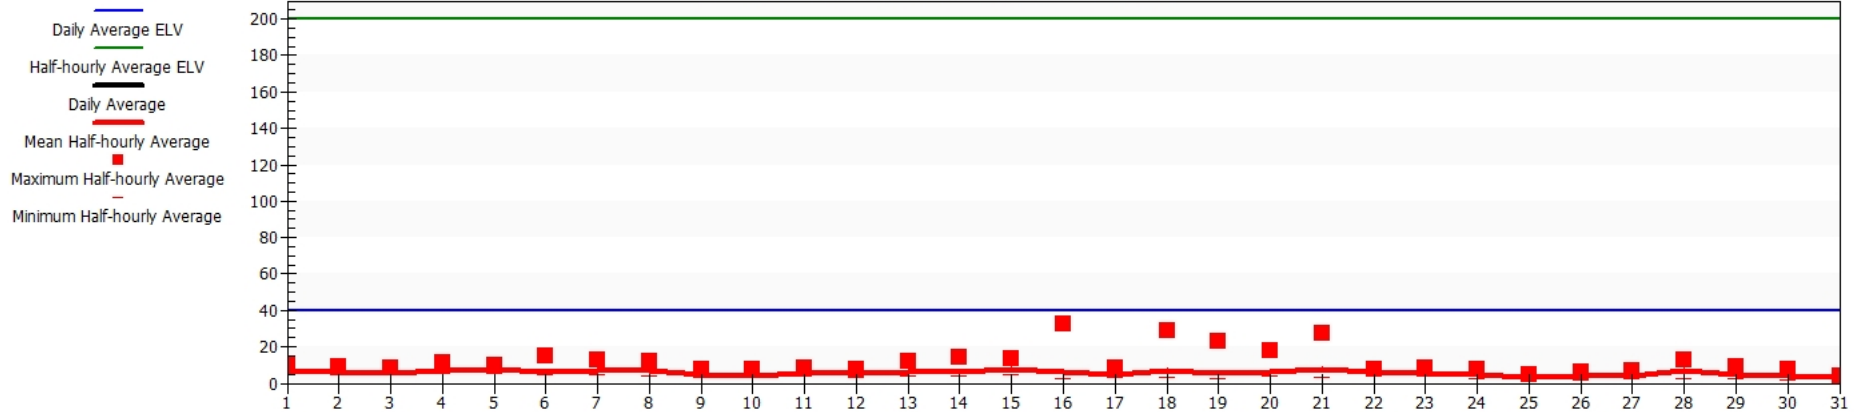

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	
	Monthly maximum	32	Maximum Half-hourly average	10	9	9	11	10	15	13	12	8	8	8	8	12	14	14	32	9	29	23	18	27	8	8	8	5	6	7	13	9	8	4	
	Monthly mean	6	Mean Half-hourly average	7	6	6	7	7	6	7	7	5	4	6	5	6	6	8	6	5	7	5	6	7	6	6	4	4	4	4	4	7	5	4	3
	Monthly minimum	2	Minimum Half-hourly average	5	5	5	5	6	5	5	4	3	3	4	4	4	4	5	3	3	3	3	4	3	5	4	2	2	2	2	2	3	2	2	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	
	Monthly maximum	8	Daily average	7	6	6	7	7	6	7	7	5	4	6	5	6	6	8	6	5	7	5	6	7	6	6	4	4	4	4	7	5	4	3	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of December 2024

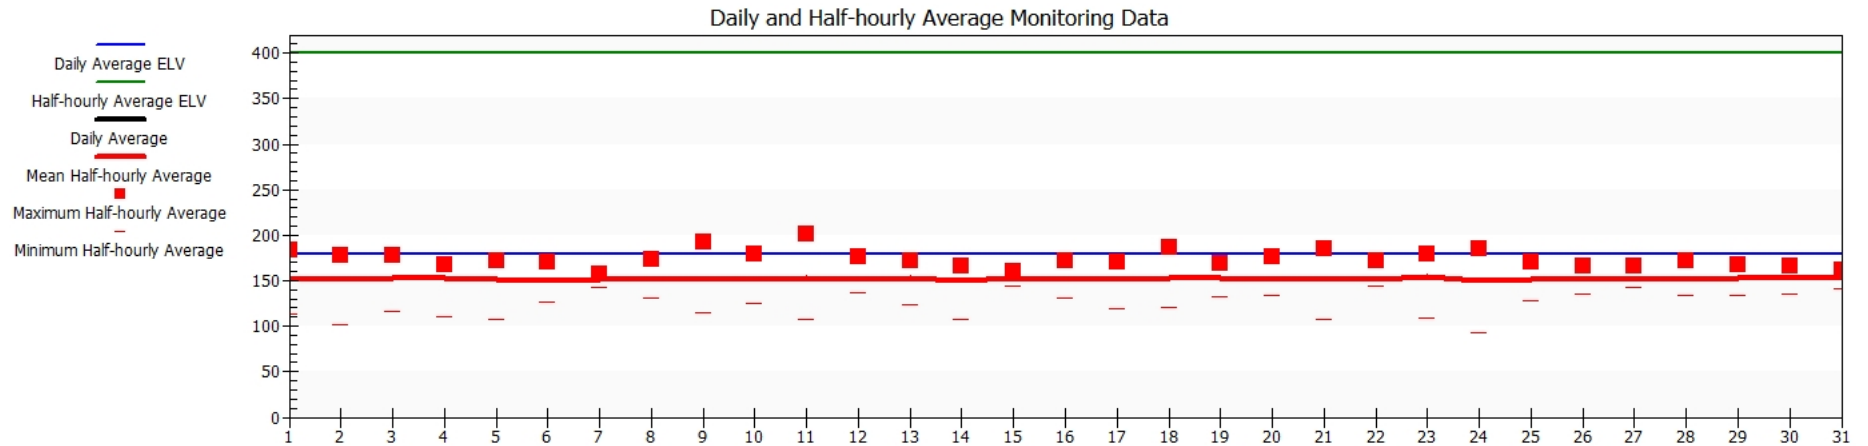

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400		
	Monthly maximum	202	Maximum Half-hourly average	183	177	178	168	173	171	158	174	193	179	202	176	172	165	160	172	171	187	169	176	186	172	179	186	171	166	166	172	168	166	162	
	Monthly mean	152	Mean Half-hourly average	152	152	153	152	152	150	152	152	152	152	152	152	152	150	152	152	152	152	152	152	152	152	154	150	152	152	152	152	153	152	153	
	Monthly minimum	93	Minimum Half-hourly average	113	102	117	111	108	127	143	130	114	125	108	137	124	107	144	132	119	121	133	134	108	144	109	93	127	136	143	134	133	135	142	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180		
	Monthly maximum	154	Daily average	152	152	153	152	152	150	152	152	152	152	152	152	150	152	152	152	152	152	152	152	152	152	154	150	152	152	152	152	153	152	153	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....**REDACTED**.....

Date.....**23.01.25**.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of December 2024

Daily and Half-hourly Average Monitoring Data

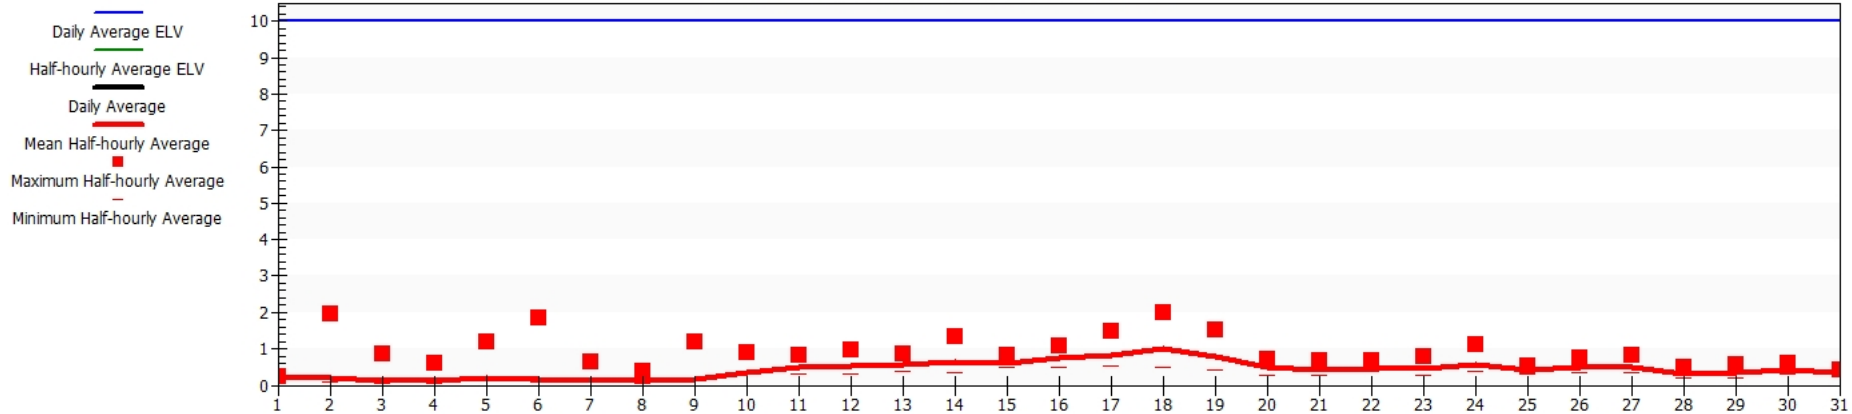

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	2.0	Maximum Half-hourly average	0.3	1.9	0.9	0.6	1.2	1.9	0.6	0.4	1.2	0.9	0.8	1.0	0.9	1.3	0.8	1.1	1.5	2.0	1.5	0.7	0.7	0.7	0.8	1.1	0.5	0.8	0.8	0.5	0.6	0.4		
	Monthly mean	0.4	Mean Half-hourly average	0.2	0.2	0.1	0.1	0.2	0.2	0.1	0.1	0.2	0.4	0.5	0.5	0.6	0.6	0.6	0.8	0.8	1.0	0.8	0.5	0.4	0.5	0.4	0.6	0.4	0.5	0.5	0.3	0.3	0.4	0.3	
	Monthly minimum	0.0	Minimum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.3	0.3	0.4	0.4	0.5	0.5	0.5	0.5	0.4	0.3	0.3	0.4	0.3	0.4	0.3	0.3	0.4	0.2	0.2	0.3	0.3	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	1.0	Daily average	0.2	0.2	0.1	0.1	0.2	0.2	0.1	0.1	0.2	0.4	0.5	0.5	0.6	0.6	0.6	0.8	0.8	1.0	0.8	0.5	0.4	0.5	0.4	0.6	0.4	0.5	0.5	0.3	0.3	0.4	0.3	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of December 2024

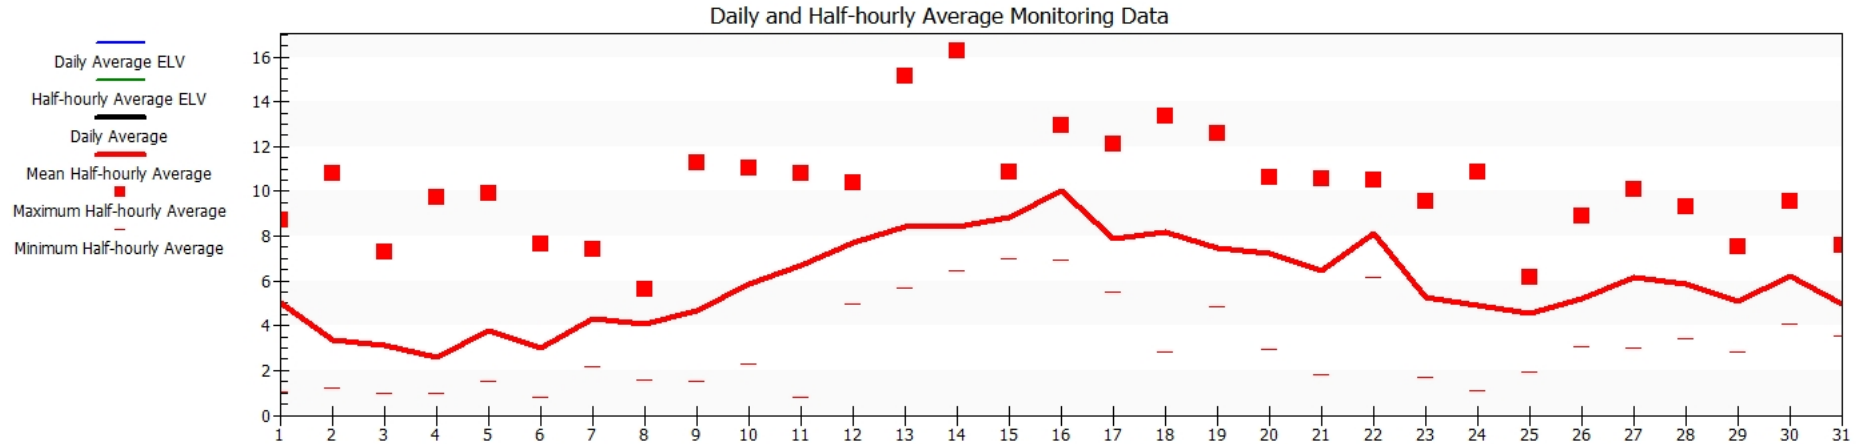

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	16.3	Maximum Half-hourly average	8.7	10.8	7.3	9.7	9.9	7.7	7.4	5.6	11.3	11.0	10.8	10.4	15.1	16.3	10.9	12.9	12.1	13.4	12.6	10.6	10.6	10.5	9.6	10.9	6.2	8.9	10.1	9.3	7.5	9.6	7.6	
	Monthly mean	5.9	Mean Half-hourly average	5.0	3.4	3.2	2.6	3.8	3.0	4.3	4.1	4.7	5.8	6.7	7.7	8.4	8.4	8.8	10.0	7.9	8.2	7.4	7.2	6.5	8.1	5.3	4.9	4.6	5.2	6.2	5.8	5.1	6.2	5.0	
	Monthly minimum	0.8	Minimum Half-hourly average	1.1	1.2	1.0	1.0	1.5	0.8	2.2	1.6	1.5	2.3	0.8	5.0	5.7	6.4	7.0	6.9	5.5	2.8	4.9	2.9	1.8	6.2	1.7	1.1	2.0	3.1	3.0	3.4	2.8	4.1	3.5	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	10.0	Daily average	5.0	3.4	3.2	2.6	3.8	3.0	4.3	4.1	4.7	5.8	6.7	7.7	8.4	8.4	8.8	10.0	7.9	8.2	7.4	7.2	6.5	8.1	5.3	4.9	4.6	5.2	6.2	5.8	5.1	6.2	5.0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of December 2024

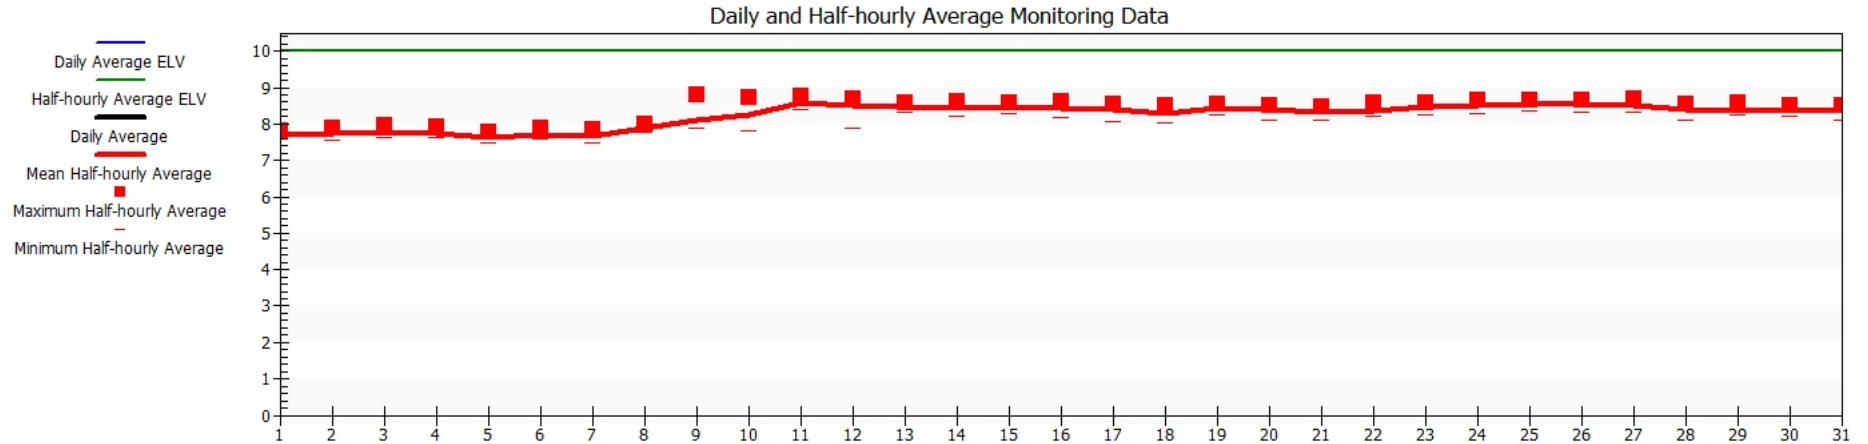

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average		Half-hourly average ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	
	Monthly maximum	9	Maximum Half-hourly average	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	Monthly mean	8	Mean Half-hourly average	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	Monthly minimum	7	Minimum Half-hourly average	8	8	8	8	7	8	7	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	9	Daily average	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....REDACTED.....

Date.....23.01.25.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of December 2024

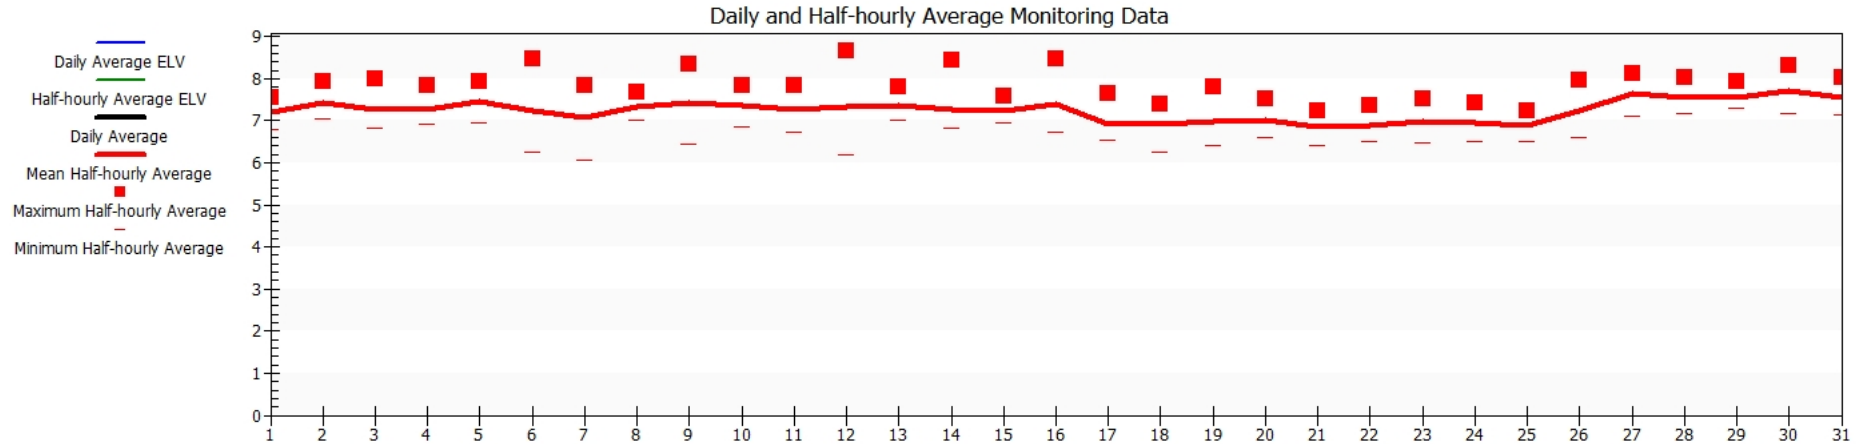

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	9	Maximum Half-hourly average	8	8	8	8	8	8	8	8	8	8	8	9	8	8	8	8	8	7	8	8	7	7	8	7	7	8	8	8	8	8	8	
	Monthly mean	7	Mean Half-hourly average	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	
	Monthly minimum	6	Minimum Half-hourly average	7	7	7	7	7	6	6	7	6	7	7	6	7	7	7	7	7	6	6	7	6	7	6	7	6	7	7	7	7	7	7	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	8	Daily average	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....**REDACTED**.....

Date.....**23.01.25**.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of December 2024

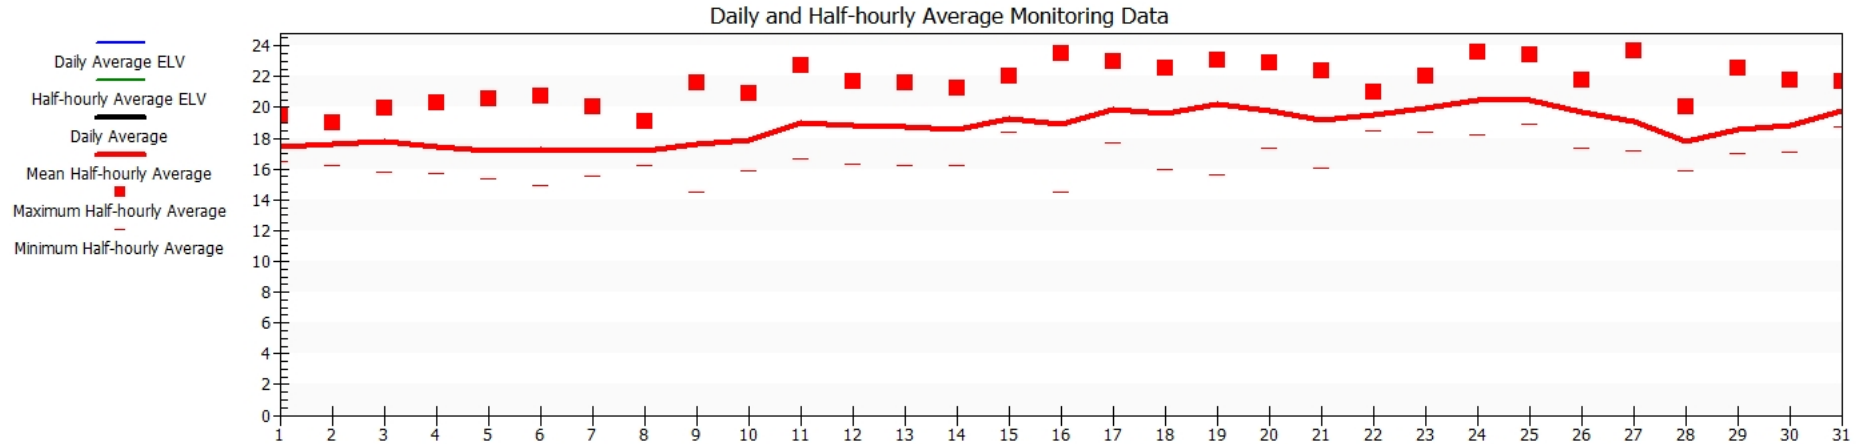

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	24	Maximum Half-hourly average	20	19	20	20	21	21	20	19	22	21	23	22	22	21	22	24	23	23	23	23	22	21	22	24	23	22	24	20	23	22	22	
	Monthly mean	19	Mean Half-hourly average	17	18	18	17	17	17	17	17	18	18	19	19	19	19	19	19	20	20	20	20	19	20	20	20	20	19	18	19	19	20		
	Monthly minimum	14	Minimum Half-hourly average	17	16	16	16	15	15	16	16	15	16	17	16	16	16	18	14	18	16	16	17	16	18	18	18	19	17	17	16	17	17	19	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	20	Daily average	17	18	18	17	17	17	17	17	18	18	19	19	19	19	19	20	20	20	20	19	20	20	20	20	20	19	18	19	19	20		
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....**REDACTED**.....

Date.....**23.01.25**.....

(Authorised to sign as a representative of the Operator)